

REFERENCE DRAWINGS

MARK 5. EQUIPMENT HATCH GA.


B1-116338

NOTES

1. HATCHES, LADDER AND GUARDS ARE TO BE INSTALLED IN ACCORDANCE WITH AUSGRID NETWORK STANDARDS AND ELECTRICAL STANDARDS.
2. HATCH FRAMES, ARE TO BE SET, TO PROVIDE A 25mm min GRADUAL FALL FROM THE FINISHED TOP SURFACE OF THE HATCH, TO THE ADJOINING FINISHED PAVED SURFACE, ON ALL FOUR SIDES.
3. WHEN HATCHES ARE INSTALLED, IN SLOPING FOOTPATHS, WALKWAYS OR RAMPS, THE FALL FROM THE FINISHED TOP SURFACE OF THE HATCH TO THE ADJOINING FINISHED PAVED SURFACE, IS TO ENSURE THAT STORMWATER, FROM ADJACENT WALLS & PAVED SURFACES, DOES NOT ENGLUF THE HATCH.

EQUIPMENT HATCH
SCALE 1:10

PERSONNEL LEAF & EQUIPMENT LEAF NOT SHOWN.
TELESCOPING GUARD NOT SHOWN.

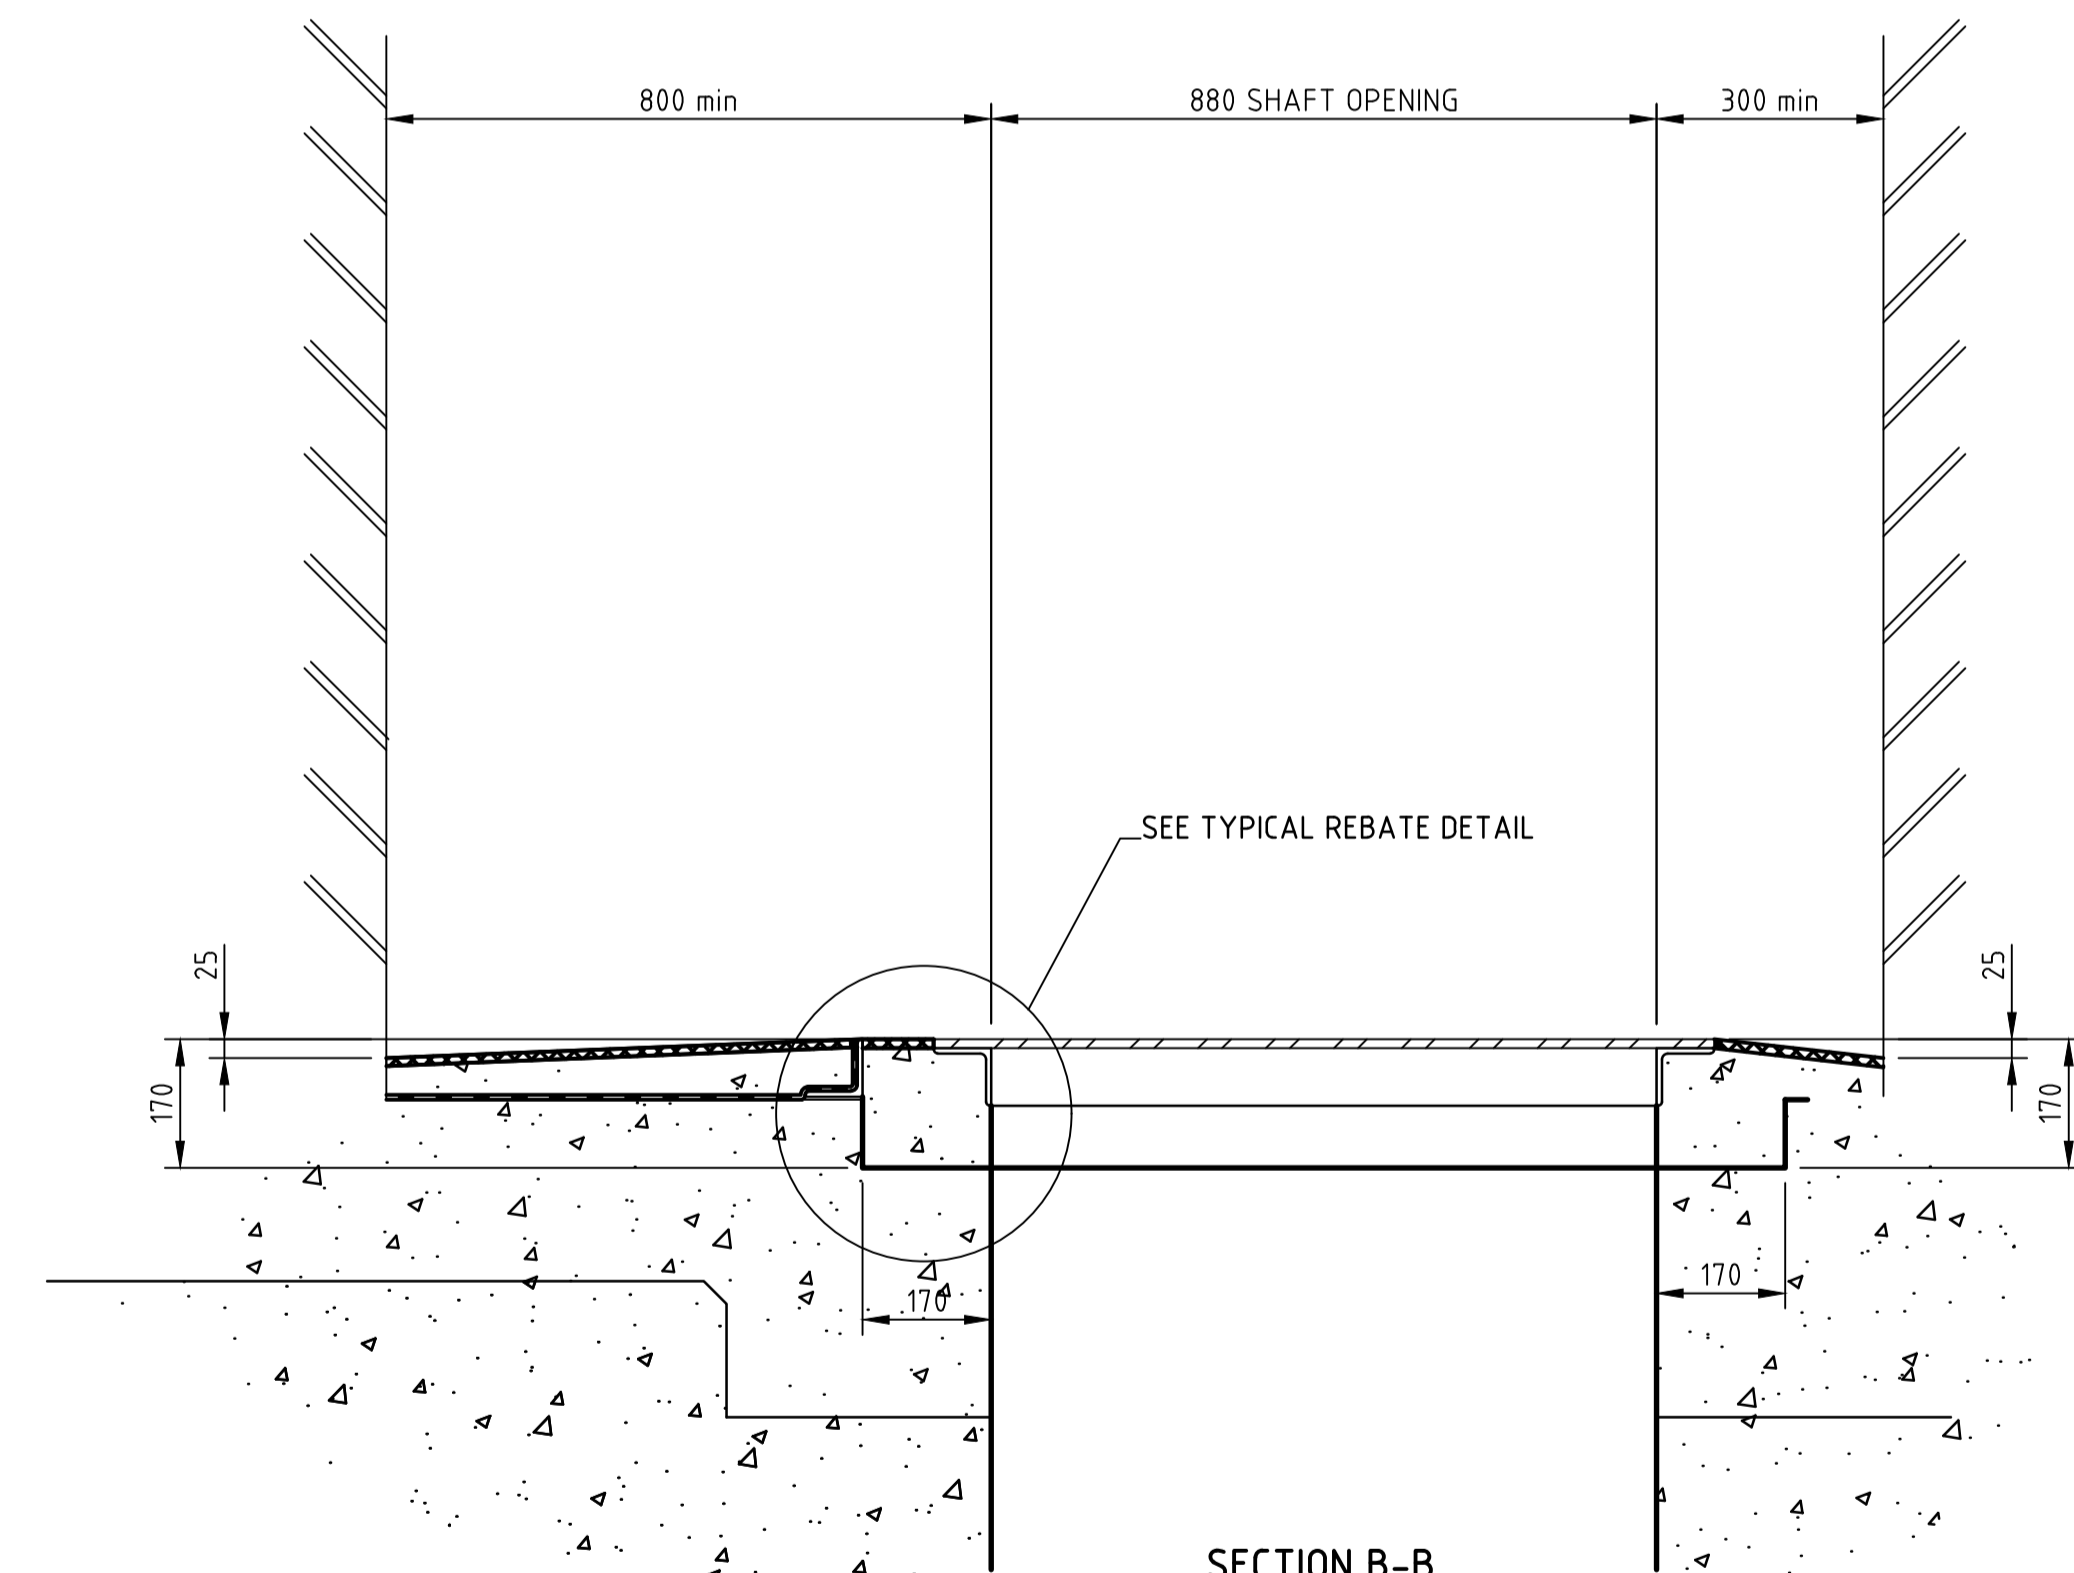

SECTION B-B
SCALE 1:10
LADDER & GUARD NOT SHOWN

<div>CAD DRAWING</div> <div>DO NOT MANUALLY AMEND</div> <div>A M E N D M E N T S</div> <div>11. DRAWING REDRAWN ON ACAD & CLARIFIED. TYPICAL REBATE DETAIL ADDED. PERSONAL HATCH REMOVED.</div> <div>RG APPROVED: 05/1991 PN: KEN 24958</div> <div>12. PERSONNEL LEAF SIDE DISTANCE REVISED. (WAS 510mm) SECTION B-B DISTANCE 300mm WAS 180mm. TITLE ALTERED.</div> <div>JCW CHECKED: 27/06/2005 PN: PWJ IWR ES 103/59/1/2</div> <div>13. NEW AUSGRID BORDER & LOGO ADDED.</div> <div>RLAALA APPROVED: 11/09/2013 T.LANPARD</div> <div>14. BORDER & TITLE BLOCK UPDATED.</div> <div>M.BENNETT 09/09/2024 CHECKED: L.MARTINUZZI APPROVED: M.BENNETT</div>	<div><div>Ausgrid</div><div>24-28 Campbell Street SYDNEY NSW 2000</div></div>		<div>SCALE</div> <div>DESIGNED</div> <div>DRAWN</div> <div>CHECKED</div> <div>APPROVED</div> <div>DATE</div> <div>TRIM REF</div>	<div>AS SHOWN</div> <div>-</div> <div>RG</div> <div>KEM</div> <div>JH</div> <div>05/1991</div> <div>-</div>	<div>BASEMENT & UNDERGROUND SUBSTATION PERSONNEL & EQUIPMENT HATCH INSTALLATION</div>				H	
	<div>ISSUED FOR CONSTRUCTION</div>	<div>PROJECT NUMBER</div>	<div>24958</div>	<div>DRAWING No</div>	<div>28949</div>	<div>SHEET</div>	<div>1</div>	<div>AMD</div>		<div>14</div>