

A

B

C

D

E

F

A

B

C





D

E

F

**NOTES :**

1. THE FOLLOWING INFORMATION IS OBTAINED FROM THE PROJECT DESIGN DRAWINGS:
  - a. POLE LENGTH AND STRENGTH.
  - b. SPECIAL FOUNDATION REQUIREMENTS.
  - c. POLE EMBEDMENT DEPTH.
  - d. CONDUCTOR SIZE.
  - e. CROSSARM SIZE AND BRACE REQUIREMENTS.
  - f. STAY REQUIREMENTS.
  - g. DEVIATION ANGLE.
2. THE MAXIMUM LINE DEVIATION ANGLE TO BE CONSTRUCTED ON THIS ARRANGEMENT IS TO BE DETERMINED BY THE LINE DESIGNER.
3. POLE STEPS ARE TO BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NS128.
4. IN AREAS WHERE THE 11kV NETWORK CANNOT BE WORKED ON USING LIVE LINE TECHNIQUES, UNDERBUILT CIRCUITS SHALL BE INSTALLED WITH A MINIMUM CLEARANCE OF 1200mm. IN AREAS WHERE THE 11kV NETWORK CAN BE WORKED ON USING LIVE LINE TECHNIQUES, UNDERBUILT CIRCUITS SHALL BE INSTALLED WITH A MINIMUM CLEARANCE OF 2500mm.
5. THE LOAD AND DEVIATION ALLOWABLE ON THE EYEBOLT IS TO BE DETERMINED FROM DRG: 520324.
6. LONGROD INSULATORS ARE TO BE USED UNDER NORMAL CONDITIONS.
7. POLES SHALL BE DRILLED, SCARFED AND DRESSED ON SITE. DRILLING AND SCARFING TO BE TREATED WITH APPROVED PRESERVATIVES.
8. ALL BOLTS PASSING THROUGH TIMBER ARE TO BE COATED WITH GRAPHITE GREASE.
9. COMPOSITE FIBRE CROSSARMS ARE TO BE USED AS THE PREFERRED OPTION UNDER NORMAL CIRCUMSTANCES.
10. A 2706mm COMPOSITE FIBRE CROSSARM IS TO BE USED AS THE DEFAULT CROSSARM. FOR NARROW FEEDER ALIGNMENTS, A SHORTER CROSSARM MAY BE CONSIDERED TO OVERCOME DESIGN AND SITE CONSTRAINTS. A LONGER CROSSARM IS TO BE USED WHERE ADDITIONAL MID SPAN SEPARATION IS REQUIRED. A STEEL CROSSARM IS TO BE USED WHEN THE MAXIMUM LOAD OF THE ALTERNATE CROSSARMS IS EXCEEDED.
11. ONLY THE 2706mm COMPOSITE FIBRE CROSSARM OPTION IS SHOWN ON THIS CONSTRUCTION DRAWING. REFER TO DRGS: 262732, 514373, 15232, 514377 & 237491 FOR DRILLING PATTERN OF ALTERNATE CROSSARMS.
12. THE 690mm CROSSARM BRACES ARE TO BE USED ON A 2706mm, 2700mm, 3006mm, 3000mm, 2750mm & 3070mm CROSSARM. THE 740mm CROSSARM BRACE IS TO BE USED ON A 2406mm & 2400mm CROSSARM.
13. REFER TO DESIGNER SAFETY REPORT D23/214051 FOR ATYPICAL HAZARDS ASSOCIATED WITH THIS STANDARD CONSTRUCTION.

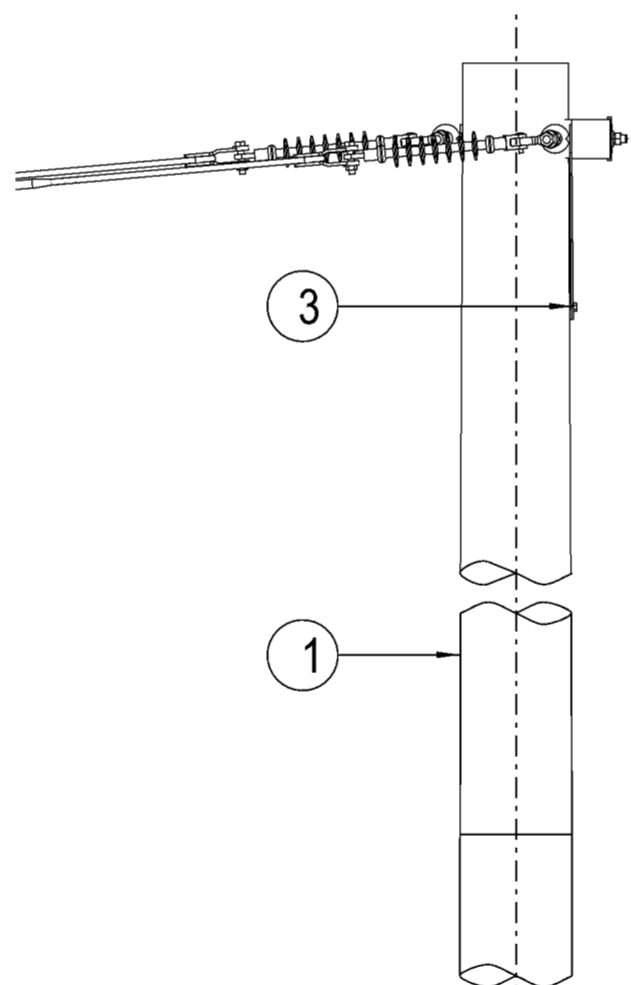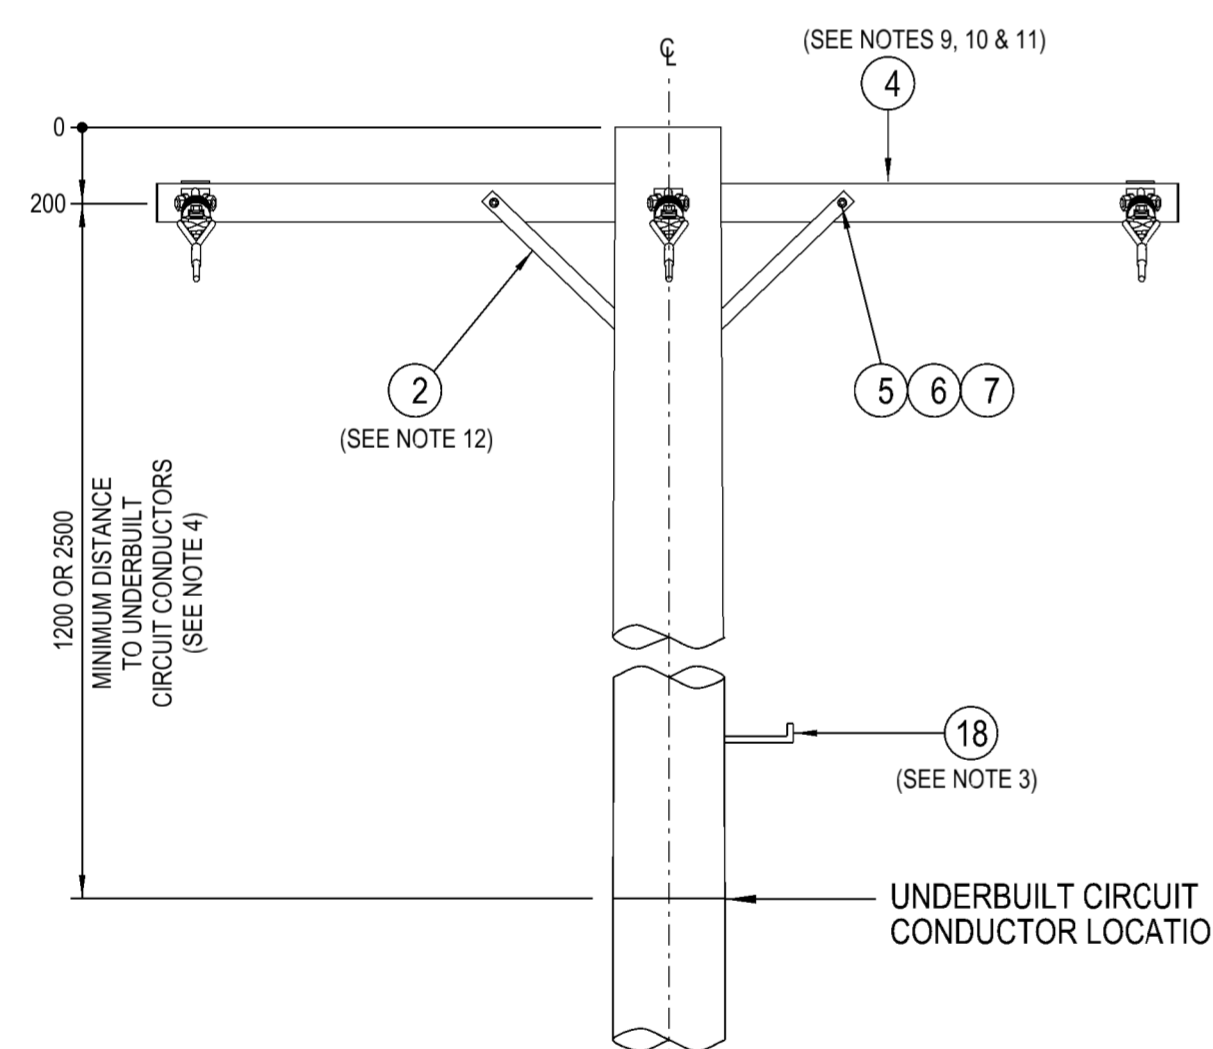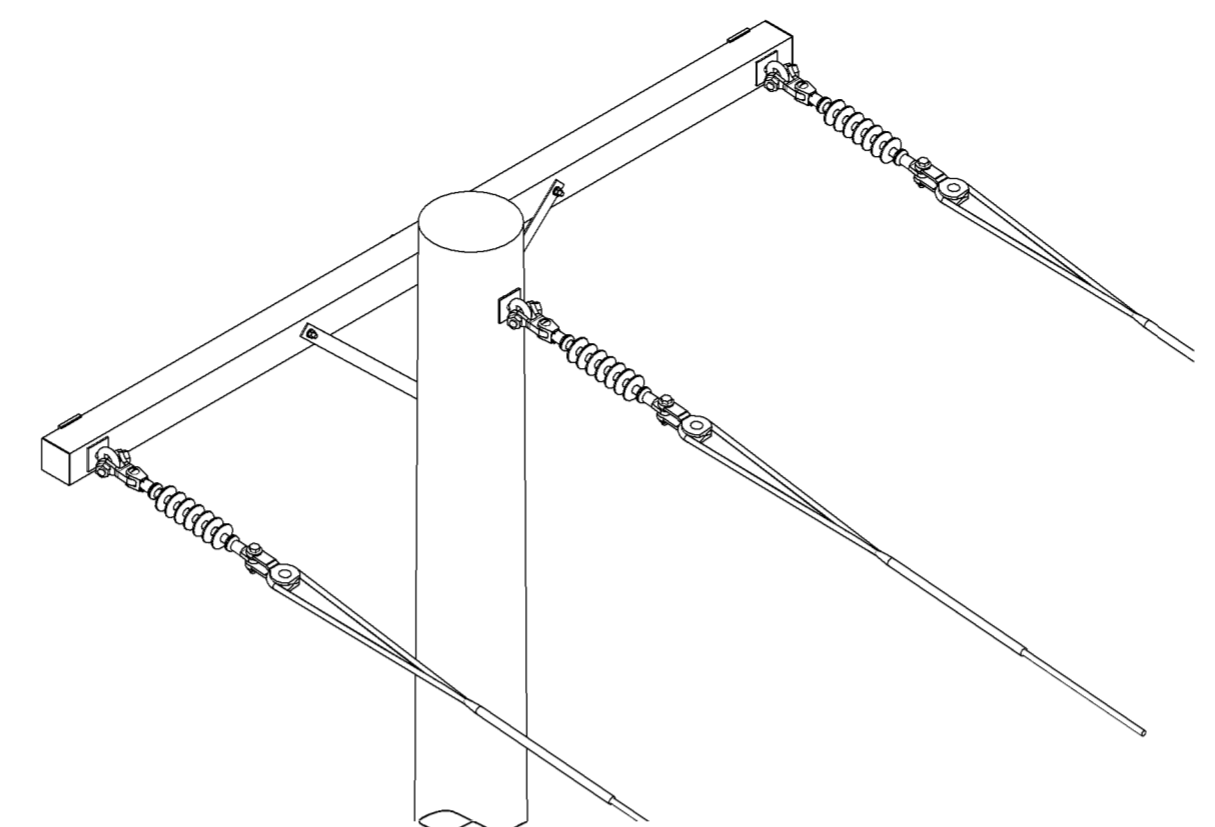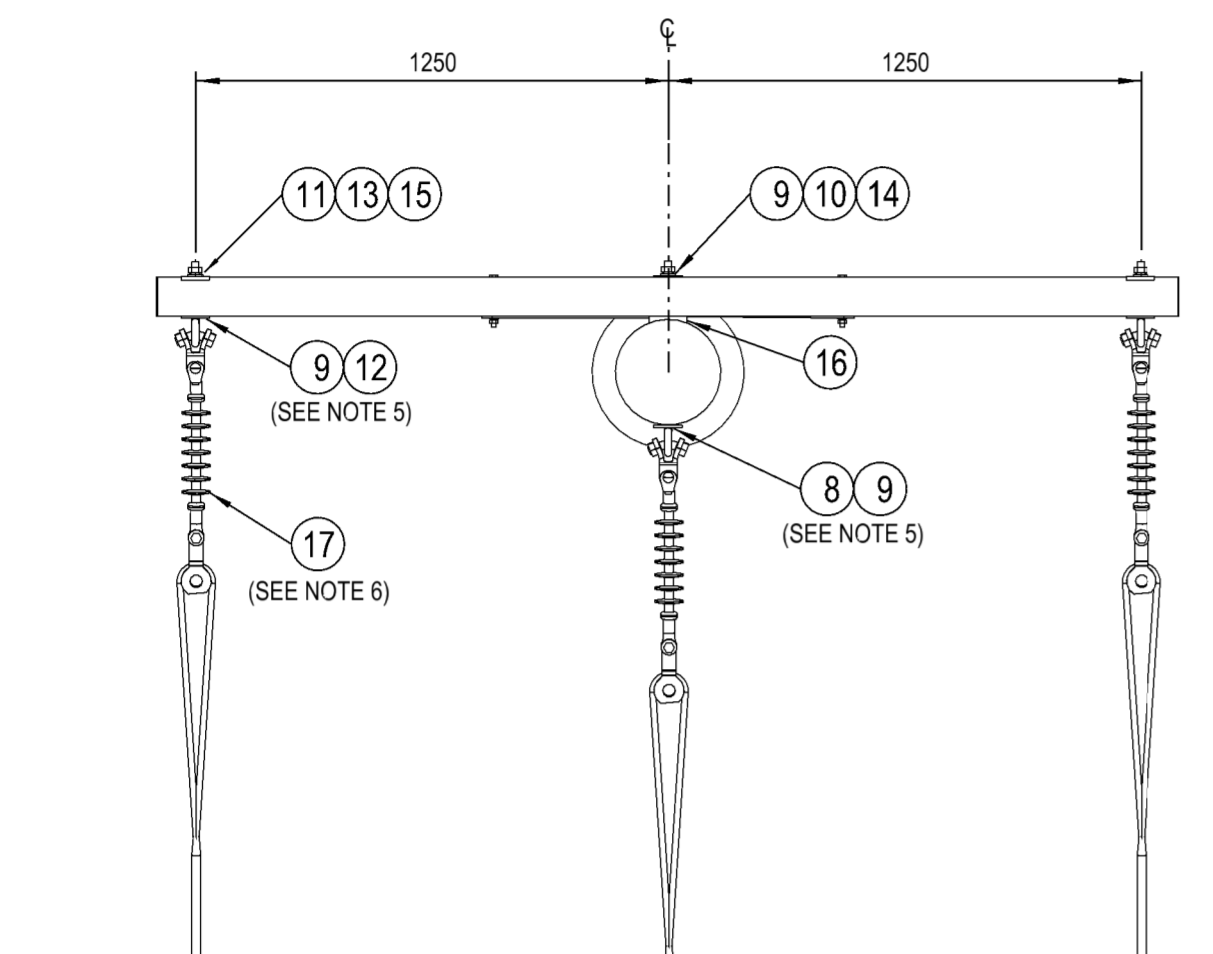

ITEM	DESCRIPTION	DRG. No	STOCK CODE	QTY
18	STEP - POLE, SCREW-IN (SEE NOTE 3)	250144	185198	A/R
17	INSULATOR - 11/22kV LONGROD, STRING ARRANGEMENT AR-2 (SEE NOTE 6)	565715		3
16	BLOCK - GAIN, ALUMINIUM, 125mm (USE WITH 2750mm & 3070mm CROSSARMS)		146282	1
	BLOCK - GAIN, ALUMINIUM, 100mm (USE WITH 2706mm, 2406mm, 3006mm, 2700mm, 2400mm & 3000mm CROSSARMS)		146274	
15	WASHER - FLAT, M20, GALVANISED (USE WITH 2700mm & 2400mm CROSSARMS)	518081	177986	2
14	WASHER - FLAT, M20, GALVANISED	518081	177986	1
13	WASHER - SQUARE, 75x75x6mm, GALVANISED (Ø22mm HOLE) (USE WITH 2750mm & 3070mm CROSSARMS)	518081	H39231	2
	WASHER - LIP, M24, GALVANISED (USE WITH 2706mm, 2406mm, 3006mm, 2700mm, 2400mm & 3000mm CROSSARMS)	518081	176912	
12	EYEBOLT - M20x200mm, GALVANISED (SEE NOTE 5)	513653	H37881	2
11	WASHER - CONICAL, M20, GALVANISED (USE WITH 2700mm & 2400mm CROSSARMS)	518082	H39655	2
	WASHER - SPRING, M20, GALVANISED (USE WITH 2706mm, 2406mm, 3006mm, 3000mm, 2750mm & 3070mm CROSSARMS)	518082	175569	
10	WASHER - CONICAL, M20, GALVANISED	518082	H39655	1
9	WASHER - SQUARE, 75x75x6mm, GALVANISED (Ø22mm HOLE)	518081	H39231	4
8	EYEBOLT - M20, GALVANISED (LENGTH TO SUIT POLE) (SEE NOTE 5)	513653		1
	WASHER - CONICAL, M12, GALVANISED (USE WITH 2400mm CROSSARM)	518082	H39639	1
7	WASHER - CONICAL, M12, GALVANISED (USE WITH 2700mm CROSSARM)	518082	H39639	2
	WASHER - SPRING, M12, GALVANISED (USE WITH 2406mm CROSSARM)	51082	H12047	1
	WASHER - SPRING, M12, GALVANISED (USE WITH 2706mm, 3006mm, 3000mm, 2750mm & 3070mm CROSSARMS)	518082	H12047	2
6	WASHER - FLAT, M12, GALVANISED (USE WITH 2406mm & 2400mm CROSSARMS)	518081	177982	2
	WASHER - FLAT, M12, GALVANISED (USE WITH 2706mm, 2700mm, 3006mm, 3000mm, 2750mm & 3070mm CROSSARMS)	518081	177982	4
	BOLT & NUT - M12x150mm, HEX, GALVANISED (USE WITH 2750mm & 3070mm CROSSARMS)	515466	46847	2
	BOLT & NUT - M12x150mm, HEX, GALVANISED (USE WITH 2400mm CROSSARM)	515466	46847	1
5	BOLT & NUT - M12x180mm, HEX, GALVANISED (USE WITH 2700mm & 3000mm CROSSARMS)	515466	46888	2
	BOLT & NUT - M12x130mm, HEX, GALVANISED (USE WITH 2406mm CROSSARM)	515466	46805	1
	BOLT & NUT - M12x130mm, HEX, GALVANISED (USE WITH 2706mm & 3006mm CROSSARMS)	515466	46805	2
	CROSSARM - 3070x125x125mm, ITEM 3, COMPOSITE FIBRE (SEE NOTES 9, 10 & 11)	237491	183935	
	CROSSARM - 2750x125x125mm, ITEM 1, COMPOSITE FIBRE (SEE NOTES 9, 10 & 11)	237491	183933	
4	CROSSARM - 3000x150x100x5mm, RHS, GALVANISED (SEE NOTES 9, 10 & 11)	514377	H23787	1
	CROSSARM - 2400x125x100mm, TYPE H2, HARDWOOD (SEE NOTES 9, 10 & 11)	15232	71910	
	CROSSARM - 2700x150x100mm, TYPE C, HARDWOOD (SEE NOTES 9, 10 & 11)	514373	H23907	
	CROSSARM - 3006x102x102mm, TYPE 13, COMPOSITE FIBRE (SEE NOTES 9, 10 & 11)	262732	186783	
	CROSSARM - 2406x102x102mm, TYPE 11, COMPOSITE FIBRE (SEE NOTES 9, 10 & 11)	262732	186781	
	CROSSARM - 2706x102x102mm, TYPE 12, COMPOSITE FIBRE (SEE NOTES 9, 10 & 11)	262732	186782	
3	SCREW - COACH, M12 x 100mm, GALVANISED		H40484	1
2	BRACE - CROSSARM, ANGLE, TYPE H, 740mm, GALVANISED (SEE NOTE 12)	46	99119	1
	BRACE - CROSSARM, FLAT, 690mm, GALVANISED (SEE NOTE 12)	514385	H17738	2
1	POLE - TIMBER (AS REQUIRED)	513988		1

ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE. DO NOT SCALE.

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS DWN: P.R. CHKD: P.J. APPD: G.F.	DATE: 08/12/2023 NOTES & MATERIAL LIST AMENDED. ASSOCIATED DRAWING ADDED.
---	--

ASSOCIATED DRAWINGS	
COMPOSITE FIBRE CROSSARM MECHANICAL LOAD REQUIREMENTS	237491
2700mm CROSSARMS FOR LV, 11kV, 22kV AND 33kV CONSTRUCTION DETAILS	514373
COMPOSITE FIBRE CROSSARMS SPECIFICATION	262732
HV TERMINATION STEEL CROSSARM CONSTRUCTION DETAILS	514377
WOODEN CROSSARMS FOR 11kV LINES	15232
20mm EYEBOLT LOADING & DEVIATION GRAPH	520324

NETWORK STANDARD  
**Ausgrid**  
145 NEWCASTLE RD WALLSEND,  
NSW 2287

SCALE	1:20
DESIGNED	-
DRAWN	PATRICIA RIOS
CHECKED	W.G
APPROVED	I.NICHOLS
DATE	07/11/94
PROJECT NUMBER	STD
PROJ/TRAK NUMBER	-

STANDARD CONSTRUCTION 11kV TERMINATION CONSTRUCTION 2-10			
SIZE	DRAWING No	SHEET	AMD
A2	513914	1	13